KEYNOTES

1. EXISTING 200A DISCONNECT SWITCH. CONNECT TO CIRCUIT SHOWN. VERIFY PROPER OPERATION AND REPAIR AS NECESSARY.
2. EXISTING 60A DISCONNECT SWITCH. CONNECT TO CIRCUIT SHOWN. VERIFY PROPER OPERATION AND REPAIR AS NECESSARY.
3. CONNECT EXISTING EXHAUST FANS TO CIRCUITS INDICATED.
4. FUSED DISCONNECT SWITCH 30A, 240V, 2P, NEMA 3R, PROVIDE FUSES PER MANUFACTURER'S INSTALLATION INSTRUCTIONS. INTERLOCK WITH HEF1.

GENERAL NOTES

A. ALL EXTERIOR DISCONNECTS SHALL BE NEMA 3R.

B. REFER TO THE MECHANICAL PLANS FOR EXACT SIZE AND LOCATION OF MECHANICAL EQUIPMENT. COORDINATE WITH MECHANICAL CONTRACTOR FOR ADDITIONAL INFORMATION.

C. PROVIDE FINAL ELECTRICAL WIRING CONNECTION OF ALL MECHANICAL EQUIPMENT INCLUDING DISCONNECTS, SWITCHES, AND JUNCTION BOXES AS REQUIRED.

D. ALL EXTERIOR RECEPTACLES SHALL BE GFCI TYPE IN A WEATHERPROOF ENCLOSURE.

E. EXISTING ELECTRICAL OUTLETS AND DEVICES ON ROOF SHALL NOT BE REMOVED OR RELOCATED WITHOUT THE LANDLORD'S PERMISSION.

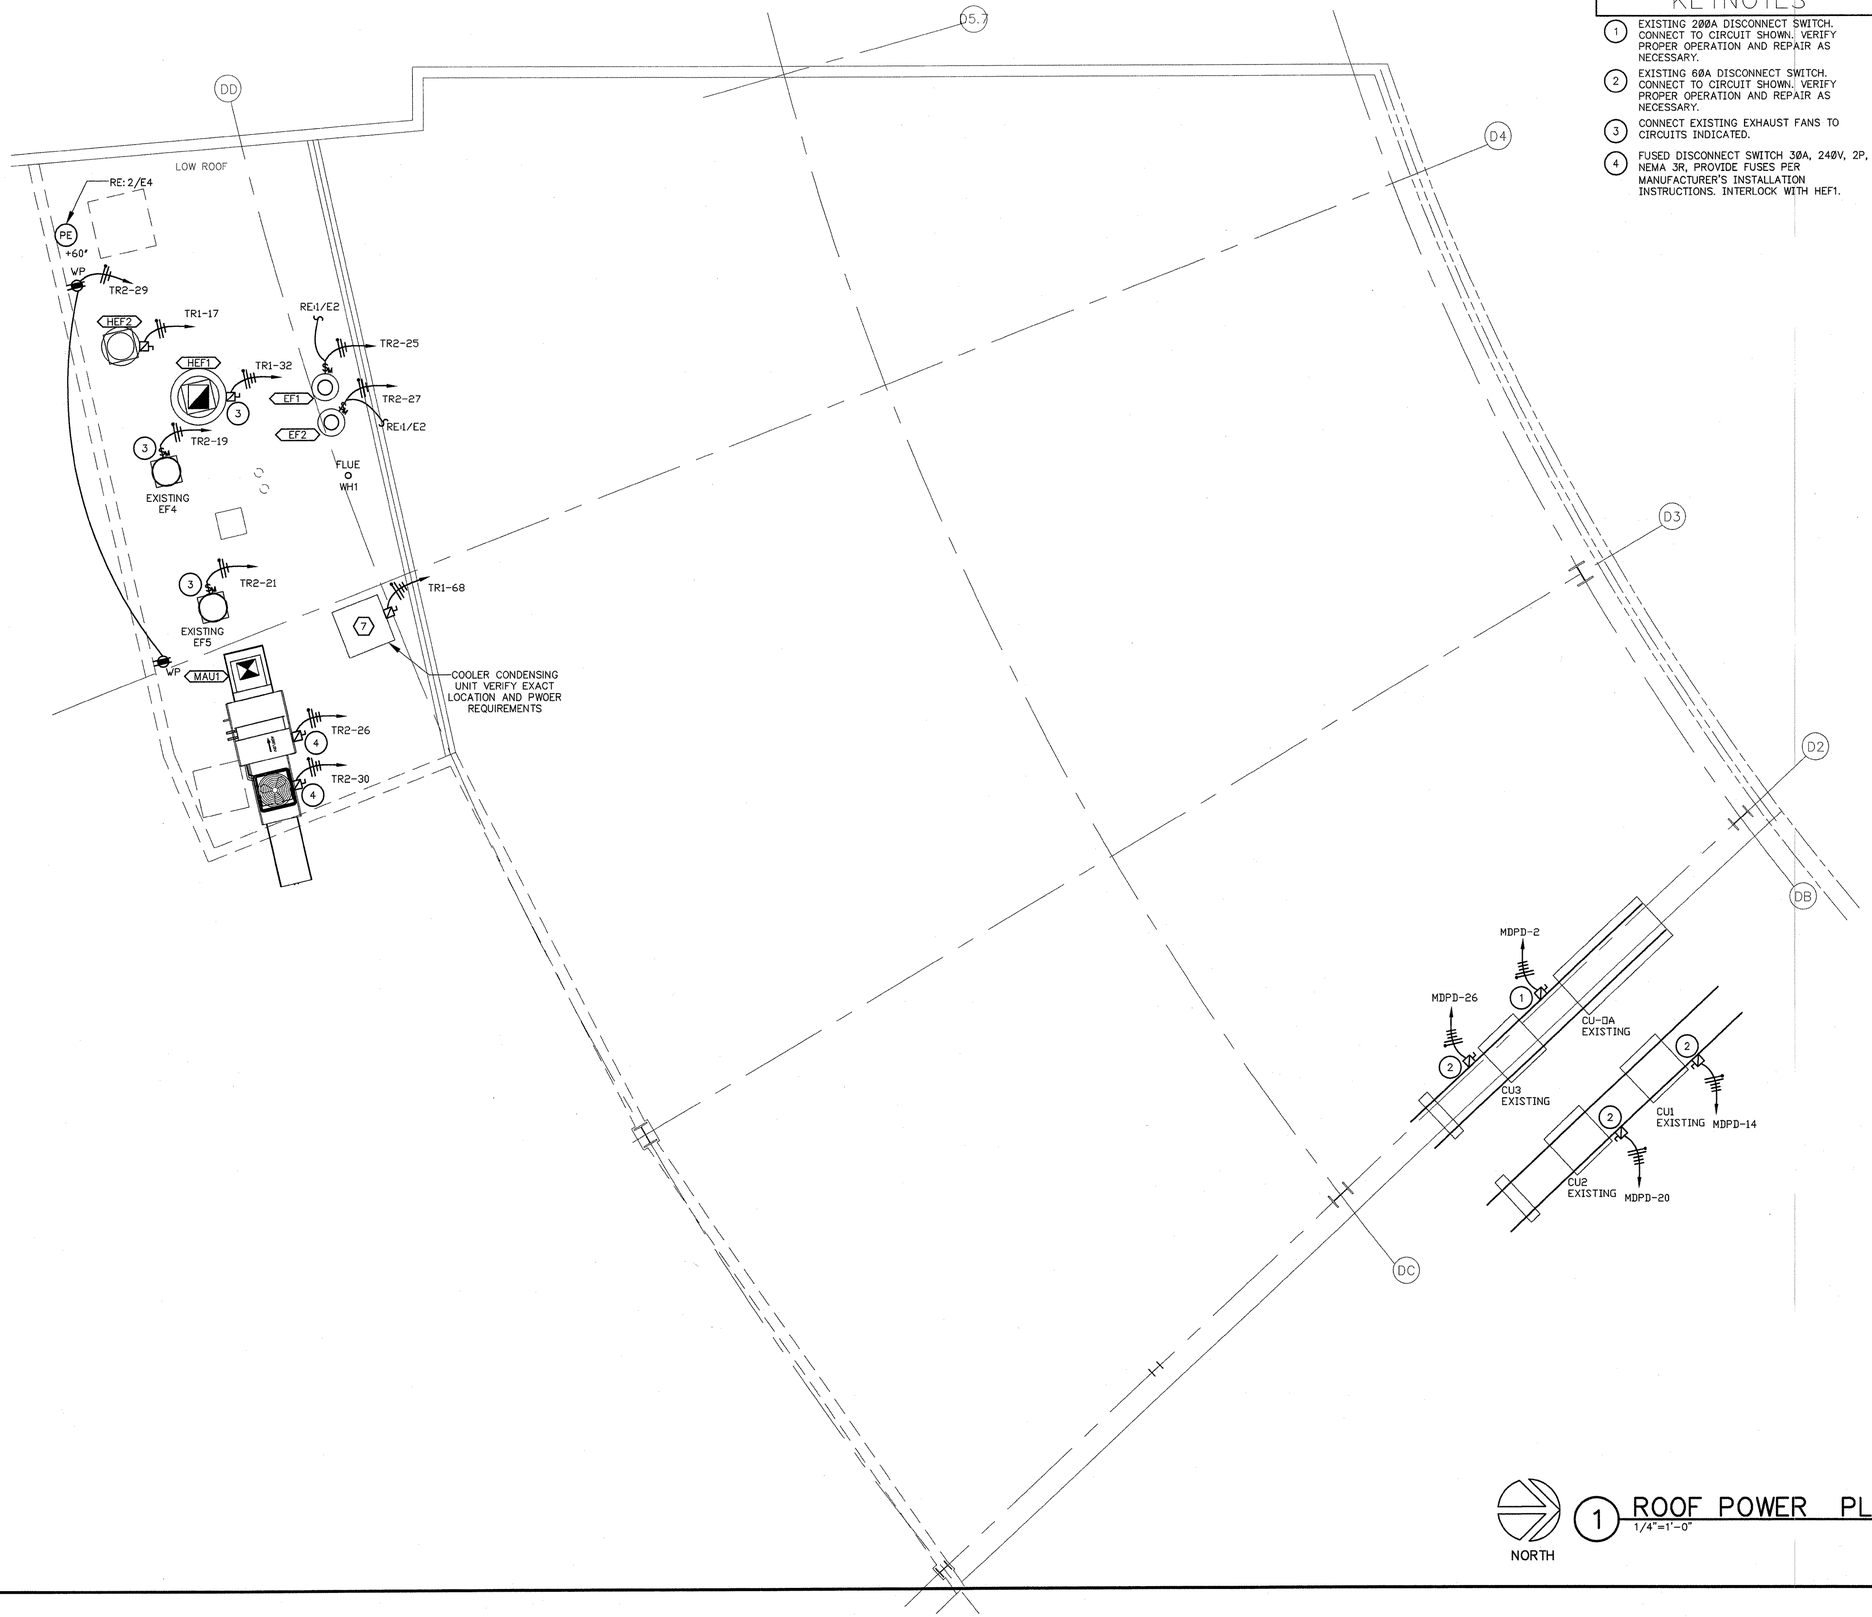

1 ROOF POWER PLAN
1/4"=1'-0"

JOHN EDLOW LICENSED PROFESSIONAL ENGINEER
No. 37632
STATE OF FLORIDA
JOHN R. EDLOW, PE
ENGINEER OF RECORD, LIC #37532

GRIMALDI'S
COAL BRICK-OVEN PIZZERIA
4000 N Scottsdale Road, Suite 203
Scottsdale, Arizona 85251
Phone: 405.664.3147 Fax: 405.582.1282

MPW ENGINEERING
Mechanical & Electrical Consulting & Service
110 W. 7TH STREET • SUITE 600 • TULSA, OK 74119
(918) 382-4088 • (918) 582-4087 FAX

DOCUMENTS FOR:
DOWNTOWN at the GARDENS
GRIMALDI'S PIZZERIA
11701 LAKE VICTORIA GARDENS AVE., STE 3101
PALM BEACH GARDENS, FL 33410

This document, and the ideas and designs incorporated herein, as an instrument of professional service, is the property of Aaron M. King, and is not to be used, in whole or in part, for any other project, without the written authorization of Aaron M. King.

Revisions:

No.	Date	Description

Project: DOWNTOWN at the GARDENS
Drawn: RWR
Approved: JEV
Issue Date: 12/28/2010

Sheet Title:
ELECTRICAL
ROOF POWER
PLAN

Sheet No:
E3