


SCHEDULE OF EXISTING BRANCH CIRCUIT PANEL "L"															
MAIN: 100 AMP MAIN CIRCUIT BREAKER						VOLTAGE: 208/120V, 3ø, 4 WIRE									
SPEC: EXISTING PANELBOARD						A/C SYMM: EXISTING									
MOUNTING: FLUSH															
DESCRIPTION	WIRE	GND.	COND.	TRIP	CKT.	A PHASE KVA	B PHASE KVA	C PHASE KVA	CKT.	TRIP	COND.	GND.	WIRE	DESCRIPTION	
RECEPTACLES	#12	#12	1/2"	20	1	1.0	1.2		2	20	3/4"	1#10	2#10	AHU-1/CU-1	
RECEPTACLES	#12	#12	1/2"	20	3		1.0   1.2		4	20					
RECEPTACLES	#12	#12	1/2"	20	5			1.0 -	6	20	-	-	-	SPARE	
RECEPTACLES	#12	#12	1/2"	20	7	1.0 -			8	20	-	-	-	SPARE	
RECEPTACLES	#12	#12	1/2"	20	9		1.0		10	20	-	-	-	SPARE	
RECEPTACLES	#12	#12	1/2"	20	11			1.0 -	12	20	-	-	-	SPARE	
RECEPTACLES	#12	#12	1/2"	20	13	1.0 -			14	20	-	-	-	SPARE	
RECEPTACLES	#12	#12	1/2"	20	15		1.0		16	20	-	-	-	SPARE	
RECEPTACLES	#12	#12	1/2"	20	17			1.0 -	18	20	-	-	-	SPARE	
RECEPTACLES	#12	#12	1/2"	20	19	1.0 -			20	20	-	-	-	SPARE	
RECEPTACLES	#12	#12	1/2"	20	21		1.0		22	20	-	-	-	SPARE	
RECEPTACLES	#12	#12	1/2"	20	23			1.0 -	24	20	-	-	-	SPARE	
RECEPTACLES	#12	#12	1/2"	20	25	1.0 -			26	20	-	-	-	SPARE	
RECEPTACLES	#12	#12	1/2"	20	27		1.0 -		28	20	-	-	-	SPARE	
CONDENSATE PUMP	#12	#12	1/2"	20	29			1.0 -	30	20	-	-	-	SPARE	
						6.2	6.2	5.0	KVA PER PHASE						
						51.6	51.6	41.6	AMPS PER PHASE						
						17.4		TOTAL KVA							

GENERAL NOTES

1. NO NEW LOAD ADDED.

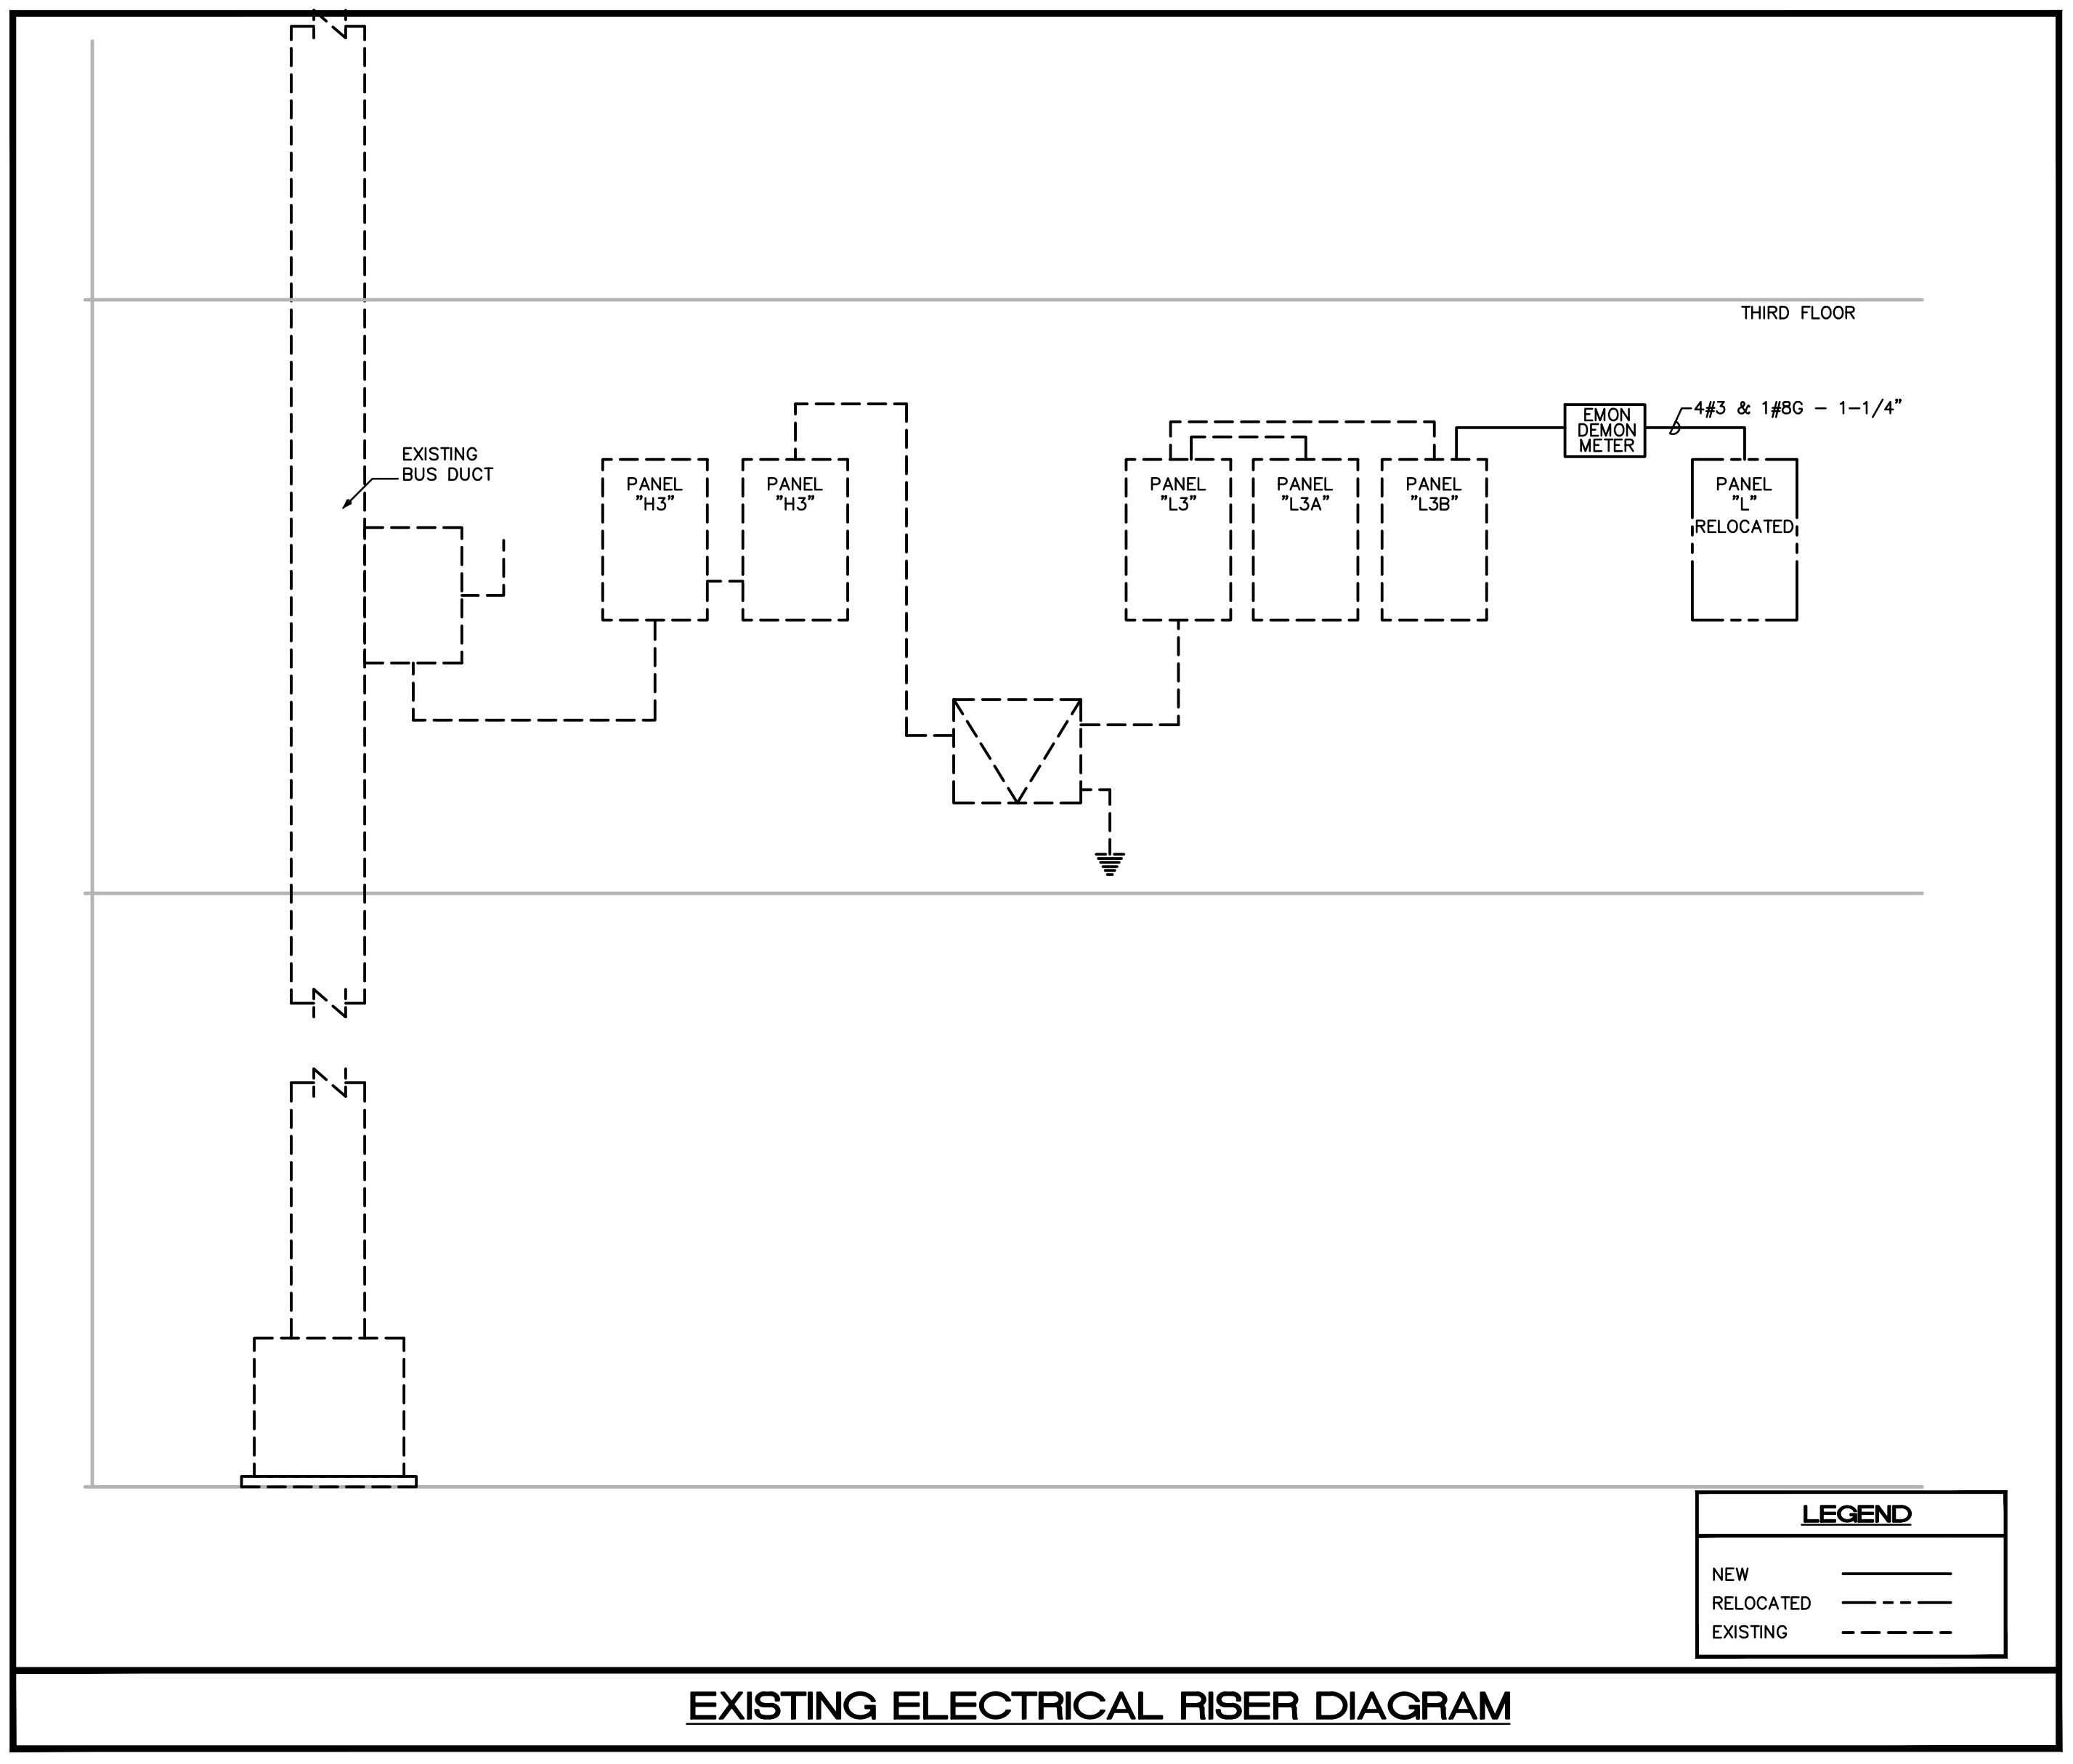

Bd

birse design inc.

5900 Woodland Lakes Drive  
Palm Beach Gardens, FL 33418  
phone 561-249-4001  
fax 772-402-8684  
AA26001615


ALLEN S BIRSE  
AR94279


BLUE CROSS BLUE SHIELD

NORTHPOINT CORPORATE CENTER  
701 NORTHPOINT PARKWAY #300  
WEST PALM BEACH, FL

PROJECT NUMBER NP21

REVISIONS

1 

2 

3

4

5

THIS DESIGN AND THESE DRAWINGS ARE THE PROPERTY OF BIRSE DESIGN INC. NO PART OF THIS WORK MAY BE REPRODUCED WITHOUT PRIOR WRITTEN PERMISSION FROM BIRSE DESIGN INC.

DRAWN BY BB


RISER  
DIAGRAM

10/19/12

E5.1

ISSUED FOR REVIEW

KAMM CONSULTING PROJECT #: 2012-0754  
PROJECT MANAGER: DUANE MILLAR



1408 Orange Avenue  
Fort Pierce, Florida 34950  
Phone 772.595.1744 Fax 772.595.1745  
engineering@kammconsulting.com  
Certification of Authorization #8189

PRINCIPAL: Brady L. Brown Florida License #58232 date: signed: