





[illegible]

- NOTES TO CONTRACTOR:
1. REFER TO ARCHITECTURAL REFLECTED CEILING PLANS FOR THE FINAL LOCATION OF ALL FIXTURES, DEVICES, ETC.
  2. VERIFY LIGHTING REQUIREMENTS WITH OWNER, VENDOR PRIOR TO BID & CONSTRUCTION.
  3. ALL SWITCHES AND THERMOSTATS SHALL BE MOUNTED @ 42" A.F. COORDINATE EXACT LOCATIONS ON WALL IN FIELD WITH ARCHITECT PRIOR TO SOULING.
  4. ALL SWITCH AND OUTLET PLATES SHALL MATCH THE COLOR OF SWITCH AND OUTLET PLATES ON 20TH FLOOR.

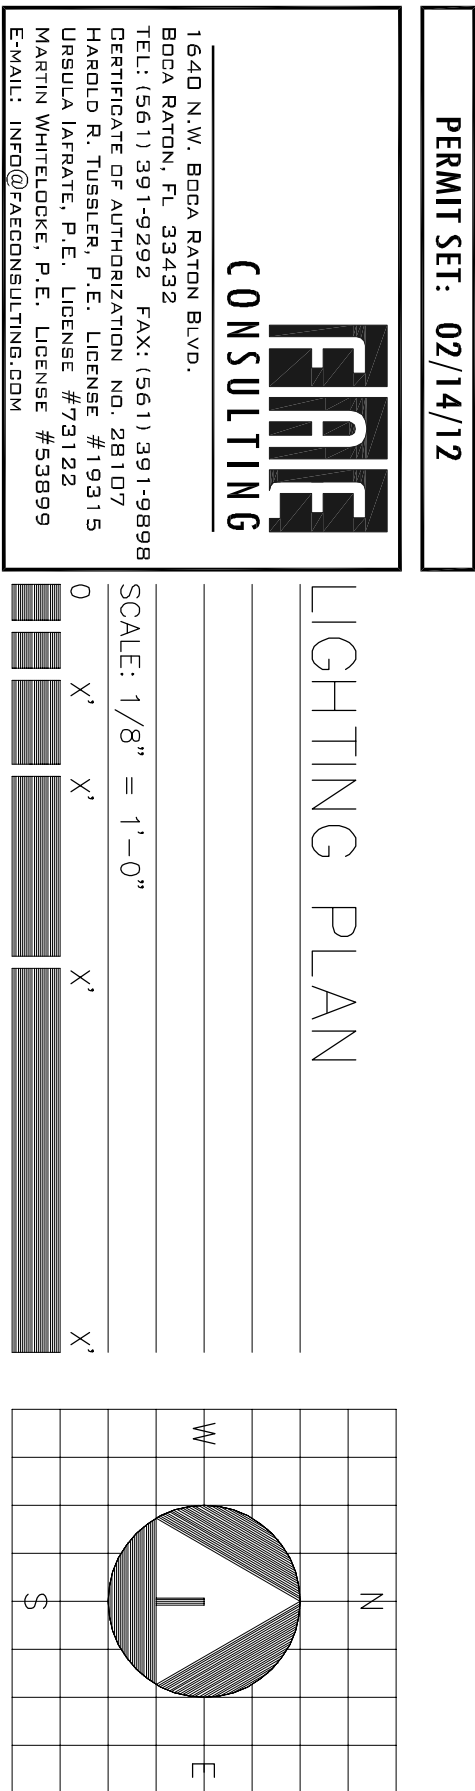
[illegible]

INTERIOR LIGHTING POWER ALLOWANCE			
PARA OUTDOOR BUILDING CODE CHAPTER 13, MEMOR 8			
CALCULATIONS FOR MEMOR 8 TO VERIFY THAT THE FOLLOWING IS CORRECT: $W = 100 \text{ W/1000 SF}$ IS			
Adequate For The Following Building Use (See Table 13.1)			
USE	ALCOHOL	USE	ALCOHOL
RECEPTION (1000)	13.1 W/100 SF	1.31 W/100 SF	139 W/100 SF
OFFICE	11.0 W/100 SF	1.10 W/100 SF	110 W/100 SF
STORAGE (5000)	15.0 W/100 SF	1.50 W/100 SF	150 W/100 SF
STORAGE (1000)	15.0 W/100 SF	1.50 W/100 SF	150 W/100 SF
MECHANICAL	15.0 W/100 SF	1.50 W/100 SF	150 W/100 SF
WORK AREA	1.10 W/100 SF	1.10 W/100 SF	110 W/100 SF
WORK AREA (100)	15.0 W/100 SF	1.50 W/100 SF	150 W/100 SF
WORK AREA (1000)	15.0 W/100 SF	1.50 W/100 SF	150 W/100 SF
WORK AREA (5000)	15.0 W/100 SF	1.50 W/100 SF	150 W/100 SF
WORK AREA (10000)	15.0 W/100 SF	1.50 W/100 SF	150 W/100 SF
WORK AREA (100000)	15.0 W/100 SF	1.50 W/100 SF	150 W/100 SF
WORK AREA (1000000)	15.0 W/100 SF	1.50 W/100 SF	150 W/100 SF
WORK AREA (10000000)	15.0 W/100 SF	1.50 W/100 SF	150 W/100 SF
WORK AREA (100000000)	15.0 W/100 SF	1.50 W/100 SF	150 W/100 SF
WORK AREA (1000000000)	15.0 W/100 SF	1.50 W/100 SF	150 W/100 SF
WORK AREA (10000000000)	15.0 W/100 SF	1.50 W/100 SF	150 W/100 SF
WORK AREA (100000000000)	15.0 W/100 SF	1.50 W/100 SF	150 W/100 SF
WORK AREA (1000000000000)	15.0 W/100 SF	1.50 W/100 SF	150 W/100 SF
WORK AREA (10000000000000)	15.0 W/100 SF	1.50 W/100 SF	150 W/100 SF
WORK AREA (100000000000000)	15.0 W/100 SF	1.50 W/100 SF	150 W/100 SF
WORK AREA (1000000000000000)	15.0 W/100 SF	1.50 W/100 SF	150 W/100 SF
WORK AREA (10000000000000000)	15.0 W/100 SF	1.50 W/100 SF	150 W/100 SF
WORK AREA (100000000000000000)	15.0 W/100 SF	1.50 W/100 SF	150 W/100 SF
WORK AREA (1000000000000000000)	15.0 W/100 SF	1.50 W/100 SF	150 W/100 SF
WORK AREA (10000000000000000000)	15.0 W/100 SF	1.50 W/100 SF	150 W/100 SF
WORK AREA (100000000000000000000)	15.0 W/100 SF	1.50 W/100 SF	150 W/100 SF
WORK AREA (1000000000000000000000)	15.0 W/100 SF	1.50 W/100 SF	150 W/100 SF
WORK AREA (10000000000000000000000)	15.0 W/100 SF	1.50 W/100 SF	150 W/100 SF
WORK AREA (100000000000000000000000)	15.0 W/100 SF	1.50 W/100 SF	150 W/100 SF
WORK AREA (1000000000000000000000000)	15.0 W/100 SF	1.50 W/100 SF	150 W/100 SF
WORK AREA (10000000000000000000000000)	15.0 W/100 SF	1.50 W/100 SF	150 W/100 SF
WORK AREA (100000000000000000000000000)	15.0 W/100 SF	1.50 W/100 SF	150 W/100 SF
WORK AREA (1000000000000000000000000000)	15.0 W/100 SF	1.50 W/100 SF	150 W/100 SF
WORK AREA (10000000000000000000000000000)	15.0 W/100 SF	1.50 W/100 SF	150 W/100 SF
WORK AREA (100000000000000000000000000000)	15.0 W/100 SF	1.50 W/100 SF	150 W/100 SF
WORK AREA (1000000000000000000000000000000)	15.0 W/100 SF	1.50 W/100 SF	150 W/100 SF
WORK AREA (10000000000000000000000000000000)	15.0 W/100 SF	1.50 W/100 SF	150 W/100 SF
WORK AREA (100000000000000000000000000000000)	15.0 W/100 SF	1.50 W/100 SF	150 W/100 SF
WORK AREA (1000000000000000000000000000000000)	15.0 W/100 SF	1.50 W/100 SF	150 W/100 SF
WORK AREA (10000000000000000000000000000000000)	15.0 W/100 SF	1.50 W/100 SF	150 W/100 SF
WORK AREA (100000000000000000000000000000000000)	15.0 W/100 SF	1.50 W/100 SF	150 W/100 SF
WORK AREA (1000000000000000000000000000000000000)	15.0 W/100 SF	1.50 W/100 SF	150 W/100 SF
WORK AREA (10000000000000000000000000000000000000)	15.0 W/100 SF	1.50 W/100 SF	150 W/100 SF
WORK AREA (100000000000000000000000000000000000000)	15.0 W/100 SF	1.50 W/100 SF	150 W/100 SF
WORK AREA (1000000000000000000000000000000000000000)	15.0 W/100 SF	1.50 W/100 SF	150 W/100 SF
WORK AREA (100)	15.0 W/100 SF	1.50 W/100 SF	150 W/100 SF
WORK AREA (1000)	15.0 W/100 SF	1.50 W/100 SF	150 W/100 SF
WORK AREA (100)	15.0 W/100 SF	1.50 W/100 SF	150 W/100 SF
WORK AREA (1000)	15.0 W/100 SF	1.50 W/100 SF	150 W/100 SF
WORK AREA (100)	15.0 W/100 SF	1.50 W/100 SF	150 W/100 SF
WORK AREA (1000)	15.0 W/100 SF	1.50 W/100 SF	150 W/100 SF
WORK AREA (100)	15.0 W/100 SF	1.50 W/100 SF	150 W/100 SF
WORK AREA (1000)	15.0 W/100 SF	1.50 W/100 SF	150 W/100 SF
WORK AREA (100)	15.0 W/100 SF	1.50 W/100 SF	150 W/100 SF
WORK AREA (1000)	15.0 W/100 SF	1.50 W/100 SF	150 W/100 SF
WORK AREA (100)	15.0 W/100 SF	1.50 W/100 SF	150 W/100 SF
WORK AREA (1000)	15.0 W/100 SF	1.50 W/100 SF	150 W/100 SF
WORK AREA (100)	15.0 W/100 SF	1.50 W/100 SF	150 W/100 SF
WORK AREA (1000)	15.0 W/100 SF	1.50 W/100 SF	150 W/100 SF
WORK AREA (100)	15.0 W/100 SF	1.50 W/100 SF	150 W/100 SF
WORK AREA (1000)	15.0 W/100 SF	1.50 W/100 SF	150 W/100 SF
WORK AREA (100)	15.0 W/100 SF	1.50 W/100 SF	150 W/100 SF
WORK AREA (1000)	15.0 W/100 SF	1.50 W/100 SF	150 W/100 SF
WORK AREA (100)	15.0 W/100 SF	1.50 W/100 SF	150 W/100 SF
WORK AREA (1000)	15.0 W/100 SF	1.50 W/100 SF	150 W/100 SF
WORK AREA (100)	15.0 W/100 SF	1.50 W/100 SF	150 W/100 SF
WORK AREA (1000)	15.0 W/100 SF	1.50 W/100 SF	150 W/100 SF
WORK AREA (100)	15.0 W/100 SF	1.50 W/100 SF	150 W/100 SF
WORK AREA (1000)	15.0 W/100 SF	1.50 W/100 SF	150 W/100 SF
WORK AREA (100)	15.0 W/100 SF	1.50 W/100 SF	150 W/100 SF
WORK AREA (1000)	15.0 W/100 SF	1.50 W/100 SF	150 W/100 SF
WORK AREA (100)	15.0 W/100 SF	1.50 W/100 SF	150 W/100 SF
WORK AREA (1000)	15.0 W/100 SF	1.50 W/100 SF	150 W/100 SF
WORK AREA (100)	15.0 W/100 SF	1.50 W/100 SF	150 W/100 SF
WORK AREA (1000)	15.0 W/100 SF	1.50 W/100 SF	150 W/100 SF
WORK AREA (100)	15.0 W/100 SF	1.50 W/100 SF	150 W/100 SF
WORK AREA (1000)	15.0 W/100 SF	1.50 W/100 SF	150 W/100 SF
WORK AREA (100)	15.0 W/100 SF	1.50 W/100 SF	150 W/100 SF
WORK AREA (1000)	15.0 W/100 SF	1.50 W/100 SF	150 W/100 SF
WORK AREA (100)	15.0 W/100 SF	1.50 W/100 SF	150 W/100 SF
WORK AREA (1000)	15.0 W/100 SF	1.50 W/100 SF	150 W/100 SF
WORK AREA (100)	15.0 W/100 SF	1.50 W/100 SF	150 W/100 SF
WORK AREA (1000)	15.0 W/100 SF	1.50 W/100 SF	150 W/100 SF
WORK AREA (100)	15.0 W/100 SF	1.50 W/100 SF	150 W/100 SF
WORK AREA (1000)	15.0 W/100 SF	1.50 W/100 SF	150 W/100 SF
WORK AREA (100)	15.0 W/100 SF	1.50 W/100 SF	150 W/100 SF
WORK AREA (1000)	15.0 W/100 SF	1.50 W/100 SF	150 W/100 SF
WORK AREA (100)	15.0 W/100 SF	1.50 W/100 SF	150 W/100 SF
WORK AREA (1000)	15.0 W/100 SF	1.50 W/100 SF	150 W/100 SF
WORK AREA (100)	15.0 W/100 SF	1.50 W/100 SF	150 W/100 SF
WORK AREA (1000)	15.0 W/100 SF	1.50 W/100 SF	150 W/100 SF
WORK AREA (100)	15.0 W/100 SF	1.50 W/100 SF	150 W/100 SF
WORK AREA (1000)	15.0 W/100 SF	1.50 W/100 SF	150 W/100 SF
WORK AREA (100)	15.0 W/100 SF	1.50 W/100 SF	150 W/100 SF
WORK AREA (1000)	15.0 W/100 SF	1.50 W/100 SF	150 W/100 SF
WORK AREA (100)	15.0 W/100 SF	1.50 W/100 SF	150 W/100 SF
WORK AREA (1000)	15.0 W/100 SF	1.50 W/100 SF	150 W/100 SF
WORK AREA (100)	15.0 W/100 SF	1.50 W/100 SF	150 W/100 SF
WORK AREA (1000)	15.0 W/100 SF	1.50 W/100 SF	150 W/100 SF
WORK AREA (100)	15.0 W/100 SF	1.50 W/100 SF	150 W/100 SF
WORK AREA (1000)	15.0 W/100 SF	1.50 W/100 SF	150 W/100 SF
WORK AREA (100)	15.0 W/100 SF	1.50 W/100 SF	150 W/100 SF
WORK AREA (1000)	15.0 W/100 SF	1.50 W/100 SF	150 W/100 SF
WORK AREA (100)	15.0 W/100 SF	1.50 W/100 SF	150 W/100 SF
WORK AREA (1000)	15.0 W/100 SF	1.50 W/100 SF	150 W/100 SF
WORK AREA (100)	15.0 W/100 SF	1.50 W/100 SF	150 W/100 SF
WORK AREA (1000)	15.0 W/100 SF	1.50 W/100 SF	150 W/100 SF
WORK AREA (100)	15.0 W/100 SF	1.50 W/100 SF	150 W/100 SF
WORK AREA (1000)	15.0 W/100 SF	1.50 W/100 SF	150 W/100 SF
WORK AREA (100)	15.0 W/100 SF	1.50 W/100 SF	150 W/100 SF
WORK AREA (1000)	15.0 W/100 SF	1.50 W/100 SF	150 W/100 SF
WORK AREA (100)	15.0 W/100 SF	1.50 W/100 SF	150 W/100 SF
WORK AREA (1000)	15.0 W/100 SF	1.50 W/100 SF	150 W/10

LIGHTING CONTROL SYMBOL LEGEND	
	ELECTRONIC TIME CLOCK INTERMATIC TIME THERMOSTAT
	OCCUPANCY SENSOR SWITCH LEVITON 5555-100A
	3-WAY SWITCH
	MOTOR RATED SWITCH
	DIMMER SWITCH
	VERRIDE SWITCH LEVITON LV440
NOTE: 1. ALL SYMBOLS MAY NOT BE USED FOR THIS PRODUCT.	

- ## GENERAL LIGHTING NOTES
1. ALL EXIT, EMERGENCY, AND BATTERY PACKS IN EXISTING BUILDINGS MUST BE WIRED AND/OR CONTROL SWITCHED.
  2. IF APPLICABLE, ALL DIMMER SWITCHES SHALL HAVE A PRESET MAINTAINING OF 10 %.
  3. ALL EXISTING LIGHTS, SECTIONS, AND EXACT LOCATIONS MUST BE VERIFIED WITH OWNER/ARCHITECT PRIOR TO CONTRACT.
  4. CONTRACTOR TO VERIFY A WAY NOT VISIBLE LIGHT QUANTITY AND LOCATION TO BE FIELD VERIFIED PRIOR TO CONSTRUCTION.
  5. ALL FIXTURES TO HAVE UL CERTIFICATION.
  6. ALL LUMINAIRES SHALL COMPLY WITH SECTION 4.073.6 OF THE NEC.

## ENERGY COMPLIANCE NOTE



<b>E2.1</b>	sheet title: <b>LIGHTING PLAN</b> file name: <b>11436_E2.1.DWG</b>		<small>           COPYRIGHT 2016 BY THE EXCLUSIVE            DESIGNER, STAN BARNES, AN INDIVIDUAL            WHO HAS ASSIGNED THE RIGHTS, TITLE            AND INTERESTS IN THE DESIGN, INVENTION            AND RIGHTS HEREIN TO STAN BARNES, INC.            ALL RIGHTS RESERVED         </small>	<b>TENANT IMPROVEMENTS FOR: NORTHBIDGE CENTER GYM FACILITY</b>  <b>515 N. FLAGLER DR., SUITE P-100 WPB, FLORIDA</b>
	project no: <b>11436</b> date: <b>02/14/12</b> drawn by: <b>AN/CJ/AS</b> checked by: <b>UI</b>	revisions:		