


1 WALL TYPE (INT. PARTITION)

2 WALL TYPE (FURRED WALL)

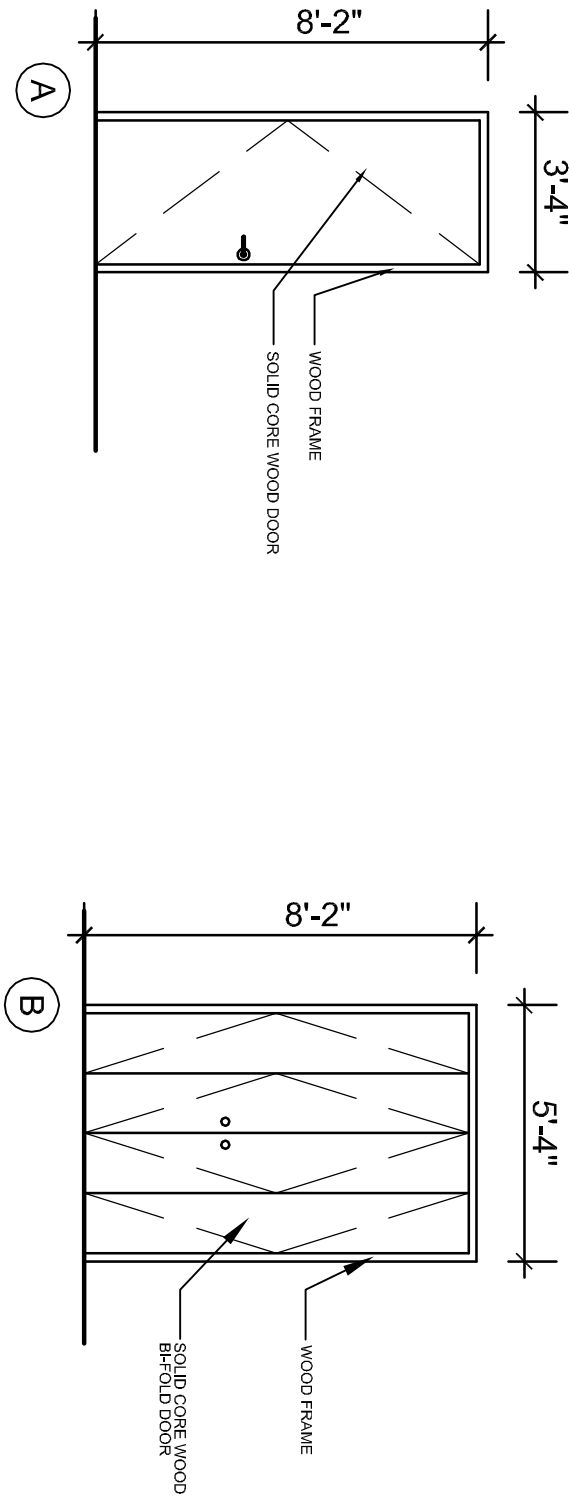


- * NEW TENANT INTERIOR DOOR HARDWARE TO ME BUILDING STANDARD
- * NEW DOOR STAY TO BE BUILDING STANDARD
- * ALL EXTERIOR TENANT DOORS TO HAVE 3" SOLID TOP RAIL, NO THROUGH BOLTING
- * ALL DOOR STOPS ARE TO BE FLOOR MOUNTED, NOT WALL MOUNTED
- * DOOR HARDWARE IS REQUIRED TO COMPLY WITH FDC 11-1.3.3 FOR ACCESSIBILITY

DOOR SCHEDULE

MARK	LABEL	DOOR					FRAME	REMARKS
		MAT	TYPE	SIZE			SIZE/MAT.	
				W	H	T		
A		WD	FLUSH	30"	80"	1-3/4"	2" WD	
B		WD	FLUSH	(2)30"	80"	1-3/4"	2" WD	B-FOLD DOOR

3 DOORS

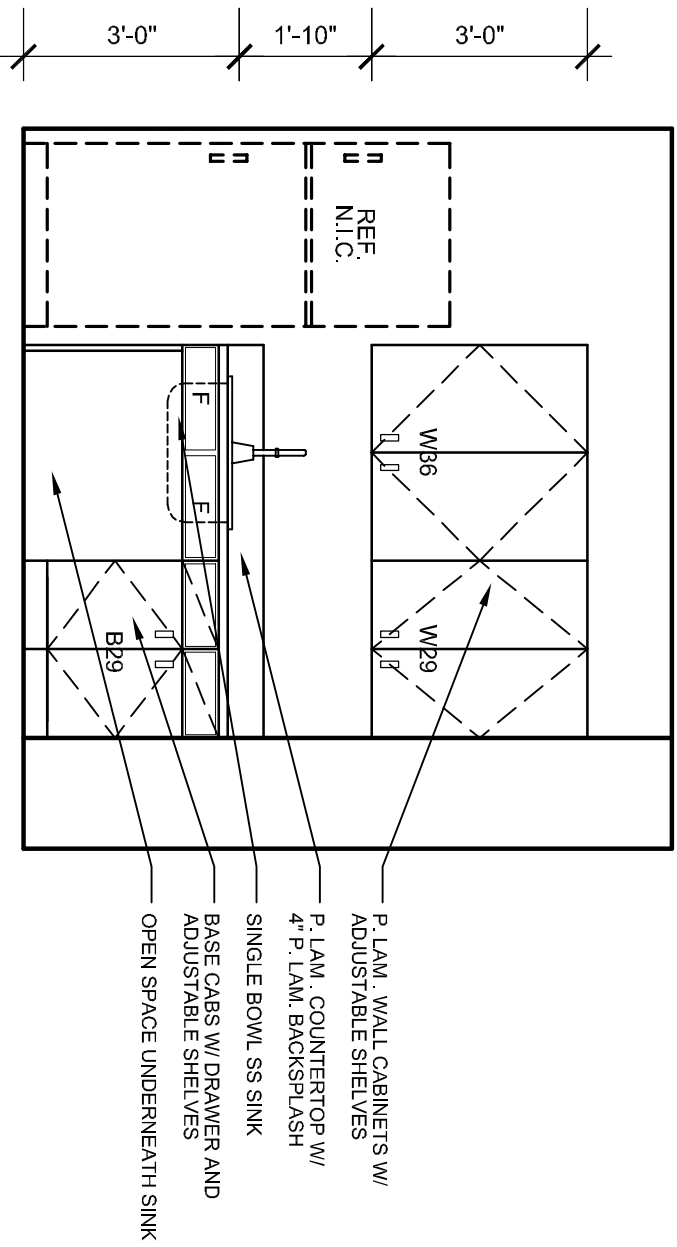

- * SINKS SHALL BE MOUNTED WITH THE COUNTER OR RIM NO HIGHER THAN 34" ABOVE THE FINISH FLOOR
- * KNEE CLEARANCE OF AT LEAST 27" HIGH, 30" WIDE AND 19" DEEP IS PROVIDED UNDERNETH
- * EACH SINK SHALL BE A MAXIMUM OF 6'17" DEEP
- * HOT WATER AND DRAIN PIPES UNDER THE SINK SHALL BE INSULATED OR OTHERWISE PROTECTED SO AS TO PROTECT AGAINST ANY CONTACT. THERE SHALL BE NO SHARP OR ABRASIVE SURFACES UNDER THE SINK
- * A CLEAR FLOOR SPACE OF AT LEAST 30" BY 48" SHALL BE PROVIDED IN FRONT OF THE SINK TO ALLOW FORWARD APPROACH. THE CLEAR FLOOR SPACE SHALL BE ON AN ACCESSIBLE ROUT AND SHALL EXTEND A MAXIMUM OF 19 INCHES UNDERNETH THE SINK
- * 19" MAX CLEAR AREA SHALL BE PROVIDED UNDERNETH THE SINK
- * ALL FAUCETS TO BE LEVER OPERATED

4 BREAK ELEVATION