


KEY NOTES

- CONTRACTOR TO VERIFY FURNITURE REQUIREMENTS WITH TENANT PRIOR TO ELECTRICAL INSTALLATION.
- CONTRACTOR TO COORDINATE TELCO ROOM REQUIREMENTS WITH TENANTS ID1-6.2 SHEET.
- (1) 12" GROUND BAR INSTALLED AT 3' AFF. BAR.PRT. NO. CHATSWORTH 13622-012.
- (2) 4" EMT CONDUIT W/ (3) 1" INNERDUCTS "HOMERUN" TO BUILDING TELEPHONE DEMARCATION ROOM. INSTALL CABLE PROTECTIVE BUSHINGS AND FIRESTOP.
- 4" EMT SLEEVES FOR NETWORK CABLING PATHS. INSTALL ABOVE LADDER RACN AND ABOVE CEILING TILE.
- CONTRACTOR TO REUSE EXISTING CIRCUITS FEEDING SPACE. 25 CIRCUITS REMOVED, 24 NEW CIRCUITS REQUIRED. NO NEW LOAD ADDED.
- AHU-1 TO BE POWERED FROM CU-1. CU-1 TO BE LOCATED ON NEW ROOF RACK ON ROOF. CU-1 TO BE CIRCUITED TO L-2.4. CU-1 TO BE METERED WITH AN EMON DEMON METER. COORDINATE WITH LANDLORD.
- INSTA HOT TO BE CIRCUITED TO EXISTING INSTA HOT CIRCUIT FOR SPACE IN PANEL H3. BREAKER TO BE 30 AMP 1Ø WITH #10 WIRE.

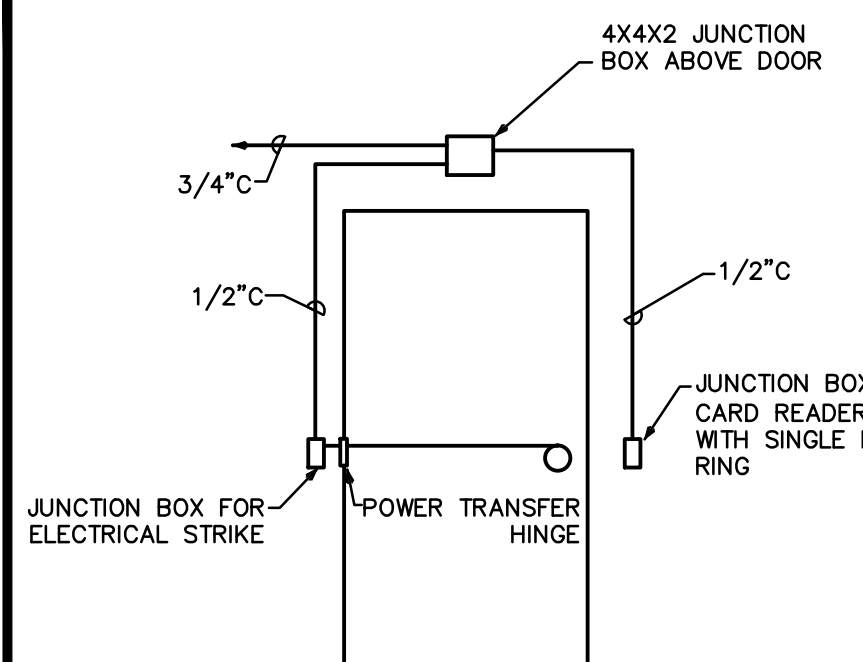

NOTE:

- THE LOCK IS AN ELECTRIFIED LOCKSET, REQUIRING POWER TO BE SUPPLIED FROM THE HINGE SIDE AND A POWER TRANSFER HINGE TO BE INSTALLED. THE DOOR WILL REQUIRE A RACEWAY FROM THE HINGE TO THE LOCK BODY FOR THE WIRE TO THE LOCK.
- CONTRACTOR TO COORDINATE WITH EQUIPMENT SUPPLIER FOR EXACT MOUNTING DETAILS & REQUIREMENTS.

CARD READER CONDUIT DETAIL

NTS

POWER PLAN

1/8"=1'-0"

Bd

birse design inc.

5900 woodland lakes drive
palm beach gardens, fl 33418
phone 561-249-4001
fax 772-409-8884
A426001615

ALLEN S BIRSE
AR94279

BLUE CROSS BLUE SHIELD

NORTHPOINT CORPORATE CENTER
701 NORTHPOINT PARKWAY #300
WEST PALM BEACH, FL

PROJECT NUMBER NP21

REVISIONS

- | | |
|---|--|
| 1 | |
| 2 | |
| 3 | |
| 4 | |
| 5 | |

THIS DESIGN AND THESE DRAWINGS ARE THE PROPERTY OF BIRSE DESIGN INC. NO PART OF THIS WORK MAY BE REPRODUCED OR TRANSMITTED IN ANY FORM OR BY ANY MEANS, ELECTRONIC OR MECHANICAL, WITHOUT PERMISSION FROM BIRSE DESIGN INC.

DRAWN BY BB

POWER PLAN

10/19/12

E3.1

ISSUED FOR REVIEW

KAMM CONSULTING PROJECT # 2012-0754
PROJECT MANAGER DUANE MILLAR

KAMM Consulting
1408 Orange Avenue
Fort Pierce, Florida 34950
Phone 772.595.1744 Fax 772.595.1745
engineering@kammconsulting.com
Certification of Authorization #8189

PRINCIPAL

Brady L. Brown

Florida License #58232

date

signed